


NOTE:
IF AT "MIDSPAN" OF TRACE-SAFE® WIRE RUN
ADDITIONAL TRACE-SAFE® CLIP AND WIRE DOWN
4" PVC CAP WILL BE ALLOWED



- NOTES:
1. TRACING WIRE TO BE SINGLE CONTINUOUS LENGTH OF WIRE BETWEEN LOCATE STATIONS. IF SPLICE IS NEEDED, TVWD APPROVAL REQUIRED.
 2. PROVIDE CONCRETE PAD AROUND VALVE BOX IF LOCATED OUTSIDE OF PAVED AREAS. PER TVWD DETAIL 402.
 3. INSTALLATION OF CONDUIT UNDER CURB AND SIDEWALK SHALL UTILIZE TRENCHLESS METHOD TO AVOID DAMAGE TO SIDEWALK.
 4. INSTALL ON MAINS DEEPER THAN 5 FEET REGARDLESS OF SIZE. TRACER WIRES SHALL NOT BE INSTALLED DEEPER THAN 8 FEET, FOR PIPES DEEPER THAN 8 FEET INSTALL TRACER WIRE ABOVE PIPE AT 8 FEET DEPTH.

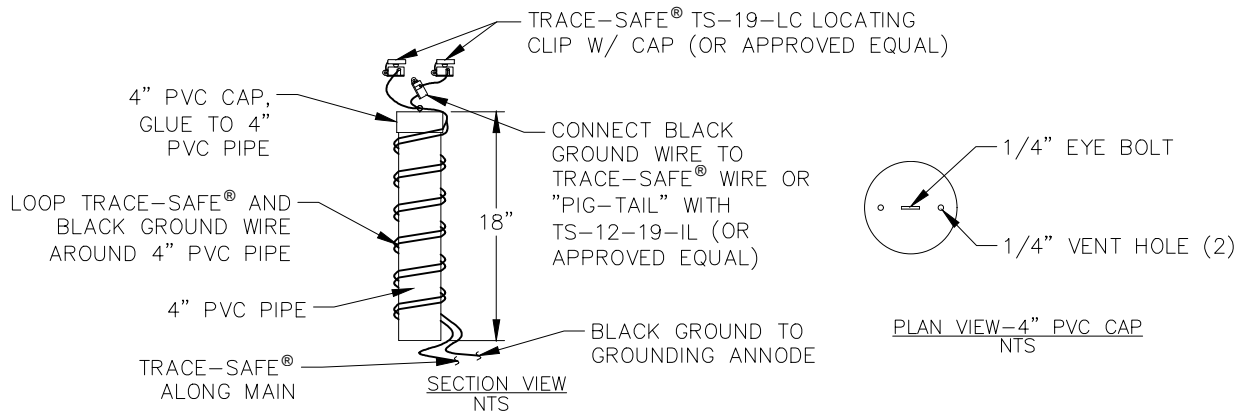

TUALATIN VALLEY
WATER DISTRICT

DESIGNED: MBA
APPROVED: NWA
SCALE: NONE

TRACER WIRE

DATE: 9/2020

DETAIL

309